




# C cable option 4C-2 - symmetrical monopole – width 2 x 1.3m, 5.6m, 15.6m

Document tendered by  
 Ms Andrea Strong  
 Received by  
 Gareth Perkins  
 Date: 18/06/23  
 Resolved to publish Yes / No

- Notes:**
1. Drawing is not to scale.
  2. All dimensions are in millimeters.
  3. Final dimensions and design to be determined during detailed design by the Civil Contractor with collaboration with HVDC Cable Contractor and Transgrid.
  4. Two (2) 525kV 1870MW symmetric monopole circuits with one (1) cable per pole.
  5. For total easement width, an additional 5m is to be added to either side of the trenches. Therefore the total easement width is ~15.6m.

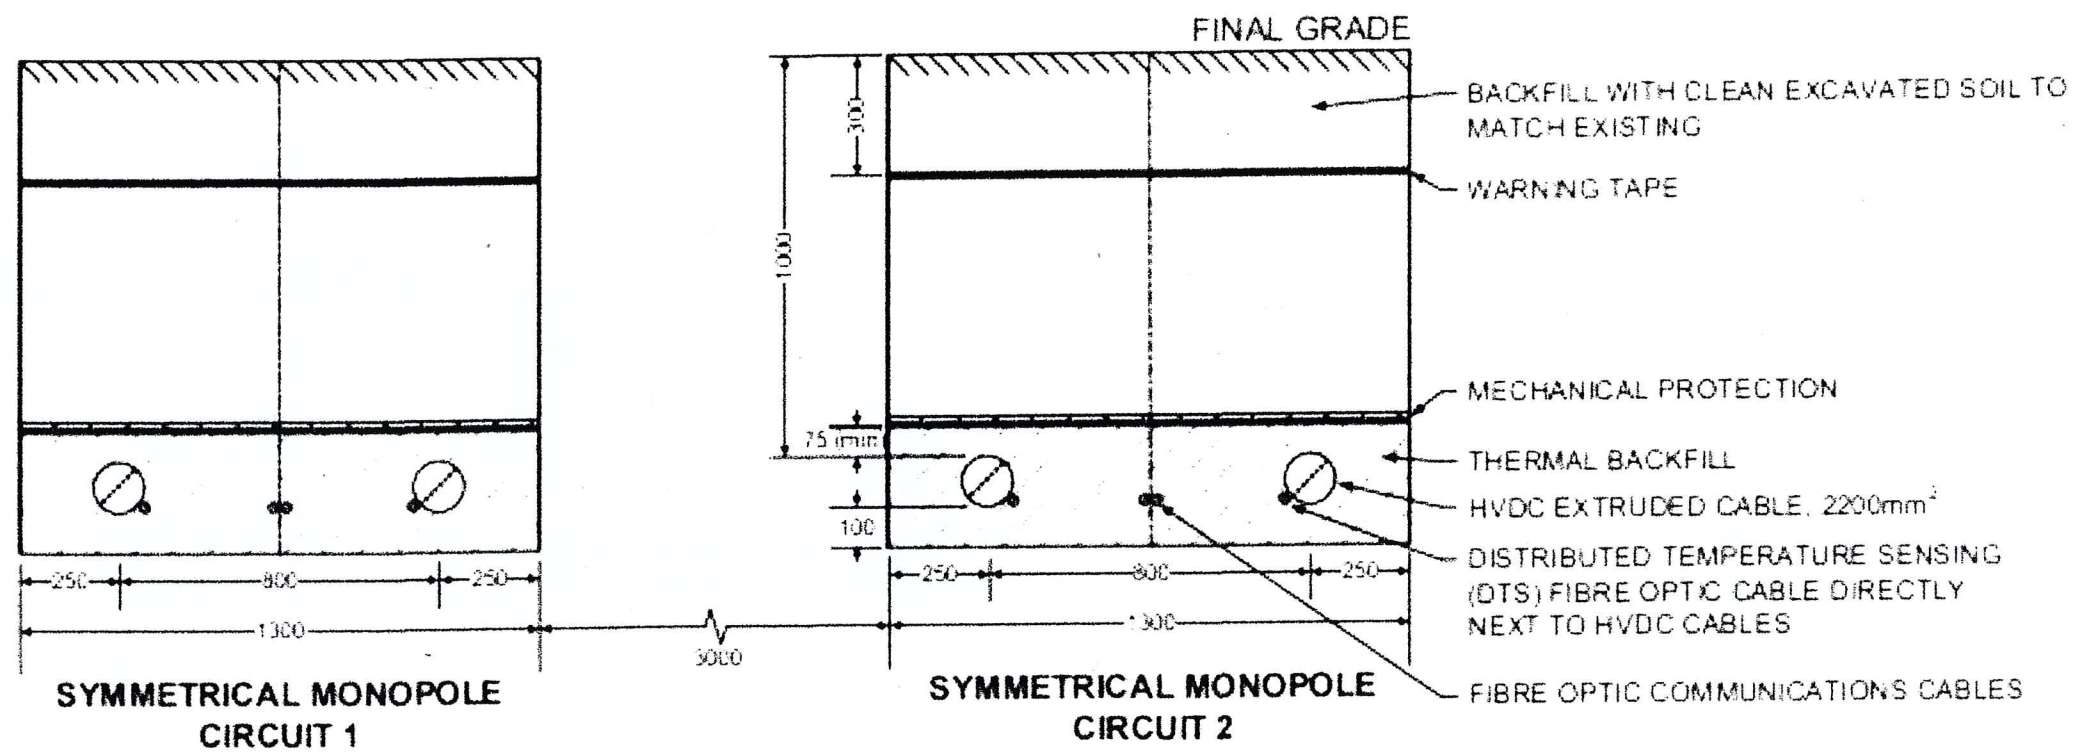

Transgrid	
<b>HUMELINK PROJECT</b>	
 Teshmont <span style="font-size: small; margin: 0 10px;">now</span>  Stantec	May-2022
HVDC CABLE SYSTEM OPTION 4C-2 CONCEPTUAL DESIGN DIRECT BURIAL BY OPEN CUT TRENCH CROSS SECTION	